


NOTES
 ALL CAPACITORS IN MICROFARADS
 UNLESS OTHERWISE SPECIFIED.
 ALL RESISTORS 1/2W 10%
 UNLESS OTHERWISE SPECIFIED.

ALL D.C. VOLTAGE MEASUREMENTS
 ARE WITH RESPECT TO GROUND
 AND ARE TAKEN AT 117VAC LINE
 VOLTAGE WITH BALLOAD CONNECTED
 TO OUTPUT AND NO SIGNAL APPLIED
 TO INPUT.

ADJUST EACH OUTPUT BIAS CONTROL
 TO PROVIDE .414VDC AT CATHODE OF
 THE ASSOCIATED TUBE.

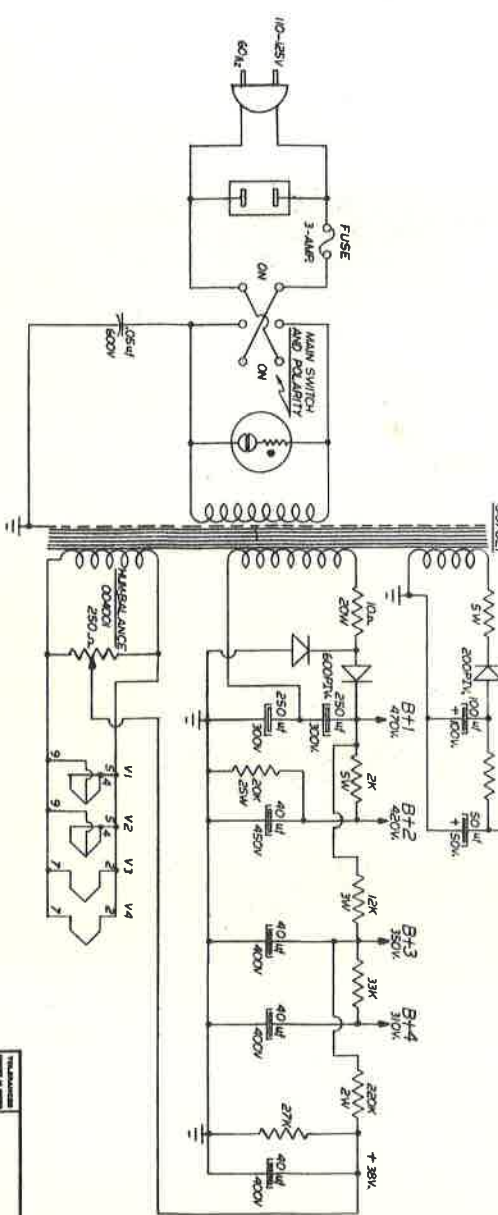

THUNDERSTAR BASS	
1	60Hz AC
2	10-25V
3	200V
4	100V
5	50V
6	25V
7	200V
8	100V
9	50V
10	25V